

Figure 1 - LV-8 Wiring Diagram

BASE

LV-8

Low Voltage Power Distribution Module

Installation and Operation Manual

BASE Electronics, Inc.

2856-C Janitell Road • Colorado Springs, CO 80906 • (719) 540-9697 • Fax (719) 540-9698

LV-8 Specifications

- Indoor Temperature Range: -25° C. to +70°C.
- Electrical
 - Maximum Voltage AC/DC: 30V
 - Maximum Total Current: 8A
 - Maximum Recommended Current per Output: 2.5A
 - Maximum Total Relay Coil Current Draw: 1A
 - Connections: Captive Screw Terminals for #14 to #22AWG Wire
- Size: 3.75" wide by 8.00" long by 2.50 maximum height (inches) with relays installed.
- Mounting: (4) 3/8 inch high nylon standoffs included.
- Configuration Jumpers
 - Relay Power Jumper: uncut = Internal Power or cut = External Power
- Special Features
 - Power Disconnect Relay Socket with Auxiliary Contact Terminals
 - Relay Bypass Switch with Auxiliary Alarm Interlock

BASE Electronics, Inc.

2856-C Janitell Road • Colorado Springs, CO 80906 • (719) 540-9697 • Fax (719) 540-9698

Limited Warranty

The LV-8 Low Voltage Power Distribution Module is warranted by BASE Electronics against manufacturing defects in materials and workmanship for a period of 2 years from date of purchase. During this period, any warranty repair required will be made at no charge for parts or labor. This warranty does not apply to any work or materials provided by any outside persons or technicians involved in the installation, unauthorized repair, connection, or testing of this product. This warranty does not cover any damage or failure caused by or attributable to Acts of God, abuse, misuse, improper or abnormal usage, faulty or improper installation or maintenance, neglect or accident. BASE Electronics is not responsible or liable for any special, consequential or indirect damages resulting from or in connection with the use or performance of this product as pertaining to economic loss, property loss, costs for removal or installation, or loss of revenues or profit. Except as provided herein, BASE Electronics makes no expressed or implied warranties. The duration of product performance for its intended purpose is limited to the duration set forth herein.

For Warranty or other repair, send the product postage prepaid to BASE Electronics and include Sender's name, company, address, phone and brief problem description. BASE Electronics will notify sender of any required repair costs not covered under this warranty prior to making such repairs.

This Warranty gives you specific legal rights. You may have other rights that vary from state to state.

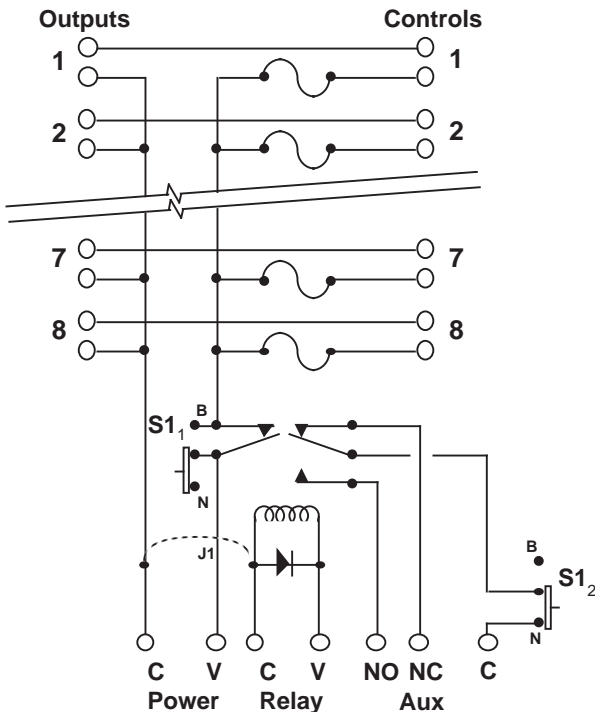


Figure 2 - LV-8 Schematic Diagram

LV-8

Low Voltage Power Distribution Module

The LV-8 distributes power from a low voltage power source to 8 individually fused outputs. Terminals are provided for control of each output by an Access Control system. A 2-pole Disconnect Relay socket is provided and easily interfaces with Fire, Life Safety or Alarm Panels to provide Emergency Power Disconnect. Relay auxiliary contact terminals are provided for alarm monitoring of the Disconnect feature. The relay can be overridden with an on-board Bypass Switch. The Bypass Switch is interlocked with the relay auxiliary contacts to provide an alarm while in the Bypass position.

The Disconnect Relay and 3AG-type Fuses are provided separately depending on the system voltage needed and output device current requirements. To meet UL Listing requirements, the relay selected should be Idec Corp., P/N RH2B-U, DPDT, 12vdc or 24vdc.

The module is 3.75" wide x 8.00" long. The installed height with relay is 2.50". Stand-offs are included for mounting the circuit board in a user-supplied enclosure.

*** WARNING ***

Turn off all power feeding the module terminals before servicing or changing input/output wiring, removing or reinstalling fuses or relays, or cutting jumpers. Failure to observe this warning may cause electrical shock hazard or may damage internal or external circuit components.

The information in this manual is believed to be accurate in all respects. However, BASE Electronics cannot assume responsibility for any consequences resulting from the use thereof. The information contained herein is subject to change and BASE Electronics may issue a revision to incorporate such changes at any time.

INSTALLATION

Locate the unit inside a UL Listed NEMA 1 enclosure (such as a BASE LVPC Low Voltage Power Cabinet) close to the source power supply. Drill (4) 0.187" diameter holes to match the (4) corner holes in the printed circuit board. Push the nylon stand-offs supplied into each hole and snap the module into place.

POWER SUPPLY WIRING

Connect the low voltage power supply input leads to the terminal strip at the lower left side of the circuit board as shown in Figure 1. Use a minimum of 18AWG copper conductors for this wiring and keep the length to the power supply as short as possible.

- V = +DC or one side of low voltage AC
- C = DC Common or the remaining side of low voltage AC

POWER DISCONNECT WIRING

A socket is provided for a 2-pole relay that is used to disconnect the output power during facility emergencies. The relay can be powered from the power feeding the LV-8 (See Figure 1 'A' wiring) or externally from a separate power supply (See Figure 1 'B' wiring). The alarm contact should be rated for the current required by the relay selected. If the relay power will be AC powered, cut diode D1 and remove it from the board.

MONITORING THE RELAY

The auxiliary output contacts of the Disconnect Relay can be monitored by an alarm system. Note that the terminals designated NO and NC (shown in Figure 1) stand for Normally Open and Normally Closed when the relay is de-energized. The terminal marked S is a Spare Terminal available for termination of an end-of-line resistor if needed.

RELAY BYPASS SWITCH

The Relay Bypass Switch can be used to over-ride the Disconnect Relay to provide continuous power to the LV-8 Outputs for service reasons or when the Disconnect Feature is not needed. The switch is interlocked to the auxiliary contacts alarm circuit to provide an alarm anytime the switch is placed in the Bypass position.

When the switch is placed in the Bypass position, the Disconnect Relay will not release the Output power. Place the switch in the Normal position for normal operation of the Disconnect Relay.

OUTPUTS AND CONTROLS

NOTE: The maximum recommended operating current at any single LV-8 output should not exceed 2.5 Amperes. The maximum recommended total operating current (all output currents added) should not exceed 8 Amperes.

Suggested wiring methods for OUTPUTS and CONTROLS are shown in Figure 1. Wiring to the access control devices connects to the Controls terminals. Two terminals are provided for each LV-8 control input.

Wiring to the output devices connects to the Output terminals. Two terminals are provided for each LV-8 output.

- V = the fused output terminal (+ when using a DC Voltage)
- C = the voltage Common terminal

Add the expected operating current ratings for each device to be powered from one LV-8 output to determine the expected operating current flow. Install a fuse for the output that will trip when this value is exceeded. The value of the fuse selected for each output may be written on the white area below the fuse for easy future reference.

Example A: Output 1 - (1) magnetic lock
operating current = 0.29A at 12 VDC
Install fuse rated just greater than 0.29A = 3/8A or 1/2A

Example B: Output 2 - (4) deadbolt locks
operating current = (4 x 0.40A) = 1.6A
Install fuse rated just greater than 1.6A = 2A

When powering devices over considerable distances, the cabling resistance may be so high that the voltage available at the device drops to an unacceptable level. To prevent this from occurring, the system cabling should be designed with adequate sized conductors. Use the Low Voltage System Cabling Design Guide in this manual for help in obtaining the desired results.

LIGHTNING, TRANSIENT AND NOISE SUPPRESSION

Lightning or transient suppression devices may be installed at the LV-8S output terminals to protect control equipment from induced voltages. A multi-screw, solid ground bar should be installed vertically next to the output side of the module for connection of metal oxide varistors, transient suppression diodes, etc. If shielded cable is used for output wiring, shield drain wires can be connected to the ground bar for line noise suppression. Run a minimum #14AWG green stranded ground wire from the ground bar to the closest Service Ground. Grounding bars of the type mentioned above can be separately supplied by BASE Electronics.

LOW VOLTAGE SYSTEM CABLING DESIGN GUIDE

With an improperly designed cabling system, the resistance of wire conductors may cause a voltage drop that could significantly affect the performance of the powered device. The resistance of a given length of cabling and its voltage drop at the given operating voltage can be calculated. This allows the effect on the powered device to be estimated with adjustments in conductor size implemented in the design stage.

Example:

A CCTV camera requires 0.29A at 24 VAC and the estimated cable length from the power supply is 800 feet. The camera specifications state that the camera will operate properly down to 21.0 VAC (a voltage drop of 3.0 volts maximum). What should be the size of the power cable conductors? From the chart below, we observe that a pair of 18AWG stranded copper conductors will have a resistance of 2 x 800 feet x 6.48 ohms/1000 feet. Using Ohm's Law: $E = I \times R$

$$E \text{ (voltage dropped)} = I \text{ (the required current)} \times R \text{ (the cabling resistance)}$$

$$E = (0.29) \times (2 \times 800 \times (6.48/1000)) = 3.007 \text{ volts}$$

Subtracting 3.007 volts from 24VAC leaves 20.993 volts available at the camera, an unacceptable level. When 16AWG conductors are used in the equation: $E = (0.29) \times (2 \times 800 \times (3.67/1000)) = 1.703 \text{ volts}$

Subtracting 1.703VAC from 24VAC leaves 22.297VAC available at the camera. Taking future expansion of a second camera into account, the estimator may decide to increase the conductors to #14AWG as follows: $E = (2 \times 0.29) \times (2 \times 800 \times (2.31/1000)) = 2.14 \text{ VAC dropped}$

When powering inductive devices (relay coils, electric strikes, magnetic locks, etc.), remember to install reversing diodes (DC powered) or metal oxide varistors (AC powered) at the device terminals or as recommended by the device manufacturer to counter the affect of Counter Magnetic Force (CMF).

Resistance of Copper Conductors					
Solid Conductors			Stranded Conductors		
Wire Gage (AWG)	Resistance (Ω/1000')		Wire Gage (AWG)	Stranding (#/AWG)	Resistance (Ω/1000')
10	1.00		10	37/26	1.11
12	1.59		12	7/20	1.45
14	2.53		14	7/22	2.31
16	4.02		16	7/24	3.67
18	6.39		18	16/30	6.48
20	10.15		20	10/30	10.32
22	16.14		22	7/30	14.74
24	25.67		24	7/32	23.30